

Revision C:

MXZ-3E54VA- ER1, MXZ-3E68VA- ER1, MXZ-4E72VA- ER1, MXZ-4E83VA- E2, ET2, ER1, MXZ-5E102VA- E2, ET2, ER1, MXZ-2E53VAHZ-ER1 and MXZ-4E83VAHZ- ER1 have been added.

Please void OBH723 REVISED EDITION-B.

OUTDOOR UNIT

HFC utilized **SERVICE MANUAL**



No. OBH723 REVISED EDITION-C

Models

MXZ-3E54VA - E1, ET1, ER1 MXZ-3E68VA - E1, ET1, ER1 MXZ-4E72VA - E1, ET1, ER1 MXZ-4E83VA - E1, E2, ET1, ET2, ER1MXZ-5E102VA - [E1], [E2], [ET1], [ET2], [ER1] MXZ-2E53VAHZ - ET, ERT MXZ-4E83VAHZ - ET, ERT

Indoor unit service manual MSZ-EF•VE Series (OBH589) MSZ-SF•VA Series (OBH555) MSZ-SF•VE Series (OBH600) MSZ-FD•VA Series (OBH488) MSZ-FH•VE Series (OBH623) MSZ-GA•VA Series (OB378) MSZ-GE•VA Series (OBH515) MSZ-GF•VE Series (OBH634) MFZ-KA•VA Series (OB409) MFZ-KJ•VE Series (OBH666) MLZ-KA•VA Series (OBH483) SLZ-KA•VA Series (OC320) SEZ-KD•VA Series (HWE07110) PLA-RP•BA Series (OCH412) PCA-RP•KA Series (OCH454) PEAD-RP•JA Series (HWE08130)



NOTE:

RoHS compliant products have <G> mark on the spec name plate.

CONTENTS

1. TECHNICAL CHANGES 3
2. PART NAMES AND FUNCTIONS 4
3. SPECIFICATION5
4. NOISE CRITERIA CURVES 12
5. OUTLINES AND DIMENSIONS 14
6. WIRING DIAGRAM 20
7. REFRIGERANT SYSTEM DIAGRAM 36
8. PERFORMANCE CURVES 44
9. ACTUATOR CONTROL 73
0. SERVICE FUNCTIONS 74
1. TROUBLESHOOTING 77
2. DISASSEMBLY INSTRUCTIONS 97

INDOOR UNITS COMBINATION SHEETS

PARTS CATALOG (OBB723)

Use the specified refrigerant only

Never use any refrigerant other than that specified.

Doing so may cause a burst, an explosion, or fire when the unit is being used, serviced, or disposed of.

Correct refrigerant is specified in the manuals and on the spec labels provided with our products.

We will not be held responsible for mechanical failure, system malfunction, unit breakdown or accidents caused by failure to follow the instructions.

<Pre><Pre>reparation before the repair service>

- · Prepare the proper tools.
- Prepare the proper protectors.
- Provide adequate ventilation.
- · After stopping the operation of the air conditioner, turn off the power-supply breaker and remove the power plug.
- Discharge the capacitor before the work involving the electric parts.

<Pre><Pre>cautions during the repair service>

- Do not perform the work involving the electric parts with wet hands.
- Do not pour water into the electric parts.
- Do not touch the refrigerant.
- Do not touch the hot or cold areas in the refrigeration cycle.
- When the repair or the inspection of the circuit needs to be done without turning off the power, exercise great caution not to touch the live parts.

Revision A:

- MXZ-2E53VAHZ- E1 and MXZ-4E83VAHZ- E1 have been added.
- Values of air flow and fan speed for MXZ-5E102VA- E1, ET1 have been modified.

Revision B:

MXZ-3E54VA- E1, ET1, MXZ-3E68VA- E1, ET1, and MXZ-4E72VA- E1, ET1 have been added.

Revision C:

• MXZ-3E54VA- ER1, MXZ-3E68VA- ER1, MXZ-4E72VA- ER1, MXZ-4E83VA- E2, ET2, ER1, MXZ-5E102VA- E2, ET2, ER1, MXZ-2E53VAHZ- ER1 and MXZ-4E83VAHZ- ER1 have been added.

TECHNICAL CHANGES

MXZ-4E83VA -E1, ET1, ER1 MXZ-5E102VA -E1, ET1, ER1

1. New model

1

MXZ-2E53VAHZ -E1, ER1

1. New model

MXZ-4E83VAHZ -E1, ER1

1. New model

MXZ-3E54VA -E1, E11, E11 MXZ-3E68VA -E1, E11, E11 MXZ-4E72VA -E1, E11, E11

1. New model

MXZ-4E83VA - E1, $E11 \rightarrow MXZ-4E83VA - E2$, E12

- 1. Fan motor has been changed.
- 2. Outdoor control P.C. board has been changed.


$MXZ-5E102VA - EI, ETI \rightarrow MXZ-5E102VA - EI, ETI$

- 1. Fan motor has been changed.
- 2. Outdoor control P.C. board has been changed.


2

PART NAMES AND FUNCTIONS


MXZ-3E54VA MXZ-3E68VA MXZ-4E72VA

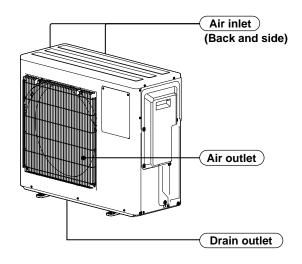

MXZ-4E83VA MXZ-5E102VA MXZ-2E53VAHZ

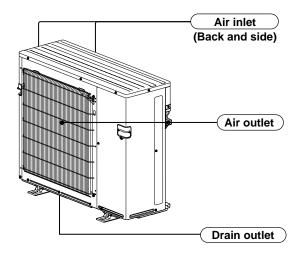

MXZ-4E83VAHZ



ACCESSORIES

	Model	MXZ-3E54VA MXZ-3E68VA MXZ-4E72VA	MXZ-4E83VA MXZ-5E102VA
1	Drain socket	1	1
2	Drain cap	2	5

SPECIFICATION

3

	Outdoor model		MXZ-3E	E54VA	
Outdoor unit power supply				Single phase 230 V, 50 Hz	
	Indoor units number		2 to	3	
٤	Piping total length	m	Max	. 50	
System	Connecting pipe length	m	Max	. 25	
တ်	Height difference (Indoor ~ Outdoor)	m	Refer to 7 REFRIGERAN	IT SYSTEM DIAGRAM.	
	Height difference (Indoor ~ Indoor)	m	Refer to 7 REFRIGERAN	IT SYSTEM DIAGRAM.	
	Function		Cooling	Heating	
	Capacity Rated frequency (MinMax.) *2	kW	5.4 (2.9 - 6.8)	7.0 (2.6 - 9.0)	
	Breaker capacity	Α	25	5	
_	Power input (Total) *1, *2	W	1,350	1,590	
Electrical data	Running current (Total) *1, *2	А	5.9	7.0	
ă	Power factor (Total) *1, *2	%	99)	
	Starting current (Total) *1, *2	Α	7.1	0	
Coeffi	cient of performance (C.O.P) (Total) *1, *2	!	4.00	4.40	
-	Model		SNB130F	GBH1T	
Compressor	Output	W	1,4	00	
npr	Current *1, *2	Α	5.72	6.62	
Cor	Refrigeration oil (Model)	L	0.7 (NE	EO22)	
5	Model		SIC-71FW	V-F764-2	
Fan motor	Current *1, *2	Α	0.:	0.2	
	Dimensions W x H x D		840 x 71	0 x 330	
	Weight kg		58	3	
	Air flow (Rated)	m ³ /h	2,334	2,376	
cial	Sound level (Rated)	dB(A)	50	53	
Special	Fan speed (Rated)	rpm	650	660	
	Refrigerant filling capacity (R410A)	kg	2.	7	

^{*1} Measured under rated operating frequency.

MSZ-EF18VE + MSZ-EF18VE + MSZ-EF18VE

NOTE: Test conditions are based on ISO 5151. (Refrigerant piping length (one way): 5 m)

COOLING INDOOR Dry-bulb temperature 27.0 °C Wet-bulb temperature 19.0 °C

OUTDOOR Dry-bulb temperature 35.0 °C Wet-bulb temperature 24.0 °C

HEATING INDOOR Dry-bulb temperature 20.0 °C

^{*2} When connected with indoor units below.

Outdoor model		MXZ-3I	E68VA	
	Outdoor unit power supply		Single 230 V,	
	Indoor units number		2 tc	3
ا ۾	Piping total length	m	Max	. 60
System	Connecting pipe length	m	Max	. 25
\ \(\oldsymbol{O} \)	Height difference (Indoor ~ Outdoor)	m	Refer to 7 REFRIGERAN	IT SYSTEM DIAGRAM.
	Height difference (Indoor ~ Indoor)	m	Refer to 7 REFRIGERAN	IT SYSTEM DIAGRAM.
	Function		Cooling	Heating
	Capacity Rated frequency (MinMax.) *2	kW	6.8 (2.9 - 8.4)	8.6 (2.6 - 10.6)
	Breaker capacity	Α	25	5
	Power input (Total) *1, *2	W	2,190	2,380
Electrical data	Running current (Total) *1, *2	Α	9.6	10.5
g g	Power factor (Total) *1, *2	%	99	9
	Starting current (Total) *1, *2	Α	10	.5
Coeffi	cient of performance (C.O.P) (Total) *1, *2		3.11	3.61
þ	Model		SNB172F	FEGH1T
Compressor	Output	W	1,8	00
l m	Current *1, *2	Α	9.22	10.12
ပိ	Refrigeration oil (Model)	L	0.7 (NE	EO22)
Fan motor	Model		SIC-71FV	V-F764-2
Fan	Current *1, *2	Α	0.:	2
	Dimensions W x H x D	mm	840 x 71	0 x 330
	Weight	kg	58	3
	Air flow (Rated)	m ³ /h	2,334	2,376
Special emarks	Sound level (Rated)	dB(A)	50	53
Special	Fan speed (Rated)	rpm	650	660
	Refrigerant filling capacity (R410A)	kg	2.	7

^{*1} Measured under rated operating frequency.

MSZ-EF18VE + MSZ-EF25VE + MSZ-EF25VE

NOTE: Test conditions are based on ISO 5151. (Refrigerant piping length (one way): 5 m)

COOLING INDOOR Dry-bulb temperature 27.0 °C Wet-bulb temperature 19.0 °C

OUTDOOR Dry-bulb temperature 35.0 °C Wet-bulb temperature 24.0 °C

HEATING INDOOR Dry-bulb temperature 20.0 °C

^{*2} When connected with indoor units below.

Outdoor model			MXZ-4E	E72VA
Outdoor unit power supply		Single 230 V,		
	Indoor units number		2 tc	0.4
Ę	Piping total length	m	Max	. 60
System	Connecting pipe length	m	Max	. 25
Ś	Height difference (Indoor ~ Outdoor)	m	Refer to 7 REFRIGERAN	IT SYSTEM DIAGRAM.
	Height difference (Indoor ~ Indoor)	m	Refer to 7 REFRIGERAN	IT SYSTEM DIAGRAM.
	Function		Cooling	Heating
	Capacity Rated frequency (MinMax.) *2	kW	7.2 (3.7 - 8.8)	8.6 (3.4 - 10.7)
	Breaker capacity	Α	25	5
_	Power input (Total) *1, *2	W	2,250	2,280
ectrica data	Running current (Total) *1, *2	Α	9.9	10.0
Electrical data	Power factor (Total) *1, *2	%	99	9
Ш	Starting current (Total) *1, *2	Α	10.	.0
Coeffi	cient of performance (C.O.P) (Total) *1, *2	2	3.20	3.77
ō	Model		SNB172F	EGH1T
ess	Output	W	2,0	00
Compressor	Current *1, *2	Α	9.46	9.56
ပိ	Refrigeration oil (Model)	L	0.7 (NE	EO22)
Fan motor	Model		SIC-71FV	V-F764-2
Fan mote	Current *1, *2	Α	0.:	2
	Dimensions W x H x D	mm	840 x 71	0 x 330
	Weight kg		59	9
	Air flow (Rated)	m ³ /h	2,334	2,376
Special	Sound level (Rated)	dB(A)	50	53
Spe em.	Fan speed (Rated)	rpm	650	660
	Refrigerant filling capacity (R410A) kg		2.	7

^{*1} Measured under rated operating frequency.

MSZ-EF18VE + MSZ-EF18VE + MSZ-EF18VE

NOTE: Test conditions are based on ISO 5151. (Refrigerant piping length (one way): 5 m) COOLING INDOOR Dry-bulb temperature 27.0 °C Wet-bulb temperature 19.0 °C

OUTDOOR Dry-bulb temperature 35.0 °C Wet-bulb temperature 24.0 °C

HEATING INDOOR Dry-bulb temperature 20.0 °C

^{*2} When connected with indoor units below.

Outdoor model		MXZ-4E	83VA	
Outdoor unit power supply		Single phase 230 V, 50 Hz		
	Indoor units number		2 to	4
ا ۾	Piping total length	m	Max.	70
System	Connecting pipe length	m	Max.	25
\ \(\oldsymbol{O}_{\text{i}} \)	Height difference (Indoor ~ Outdoor)	m	Refer to 7 REFRIGERAN	T SYSTEM DIAGRAM.
	Height difference (Indoor ~ Indoor)	m	Refer to 7 REFRIGERAN	T SYSTEM DIAGRAM.
	Function		Cooling	Heating
	Capacity Rated frequency (MinMax.) *2	kW	8.3 (3.7 - 9.2)	9.3 (3.4 - 11.6)
	Breaker capacity	Α	25	5
_	Power input (Total) *1, *2	W	2,440	2,000
Electrical data	Running current (Total) *1, *2	Α	10.7	8.8
da	Power factor (Total) *1, *2	%	99	
" [Starting current (Total) *1, *2	Α	10.7	
Coeffic	cient of performance (C.O.P) (Total) *1, *2		3.40	4.65
ō	Model		SNB220FAGMC	
Compressor	Output	W	2,200	
l mpr	Current *1, *2	Α	10.1	8.1
8	Refrigeration oil (Model)	L	0.7 (FV	(50S)
Fan motor	Model		E1, ET1: SIC-81FW-D888-9 / E2	, ET2, ER1: SIC-88FWJ-D888-1
Fan	Current *1, *2	Α	0.3	3
	Dimensions W x H x D mm		950 x 796 x 330	
	Weight kg		62	
	Air flow (Rated)	m ³ /h	3,336	3,336
Special	Sound level (Rated)	dB(A)	49	51
Spe	Fan speed (Rated)	rpm	620	620
	Refrigerant filling capacity (R410A)	kg	2.99	

^{*1} Measured under rated operating frequency.

MSZ-EF18VE + MSZ-EF18VE + MSZ-EF22VE + MSZ-EF25VE

NOTE: Test conditions are based on ISO 5151. (Refrigerant piping length (one way): 5 m)

COOLING INDOOR Dry-bulb temperature 27.0°C Wet-bulb temperature 19.0°C

OUTDOOR Dry-bulb temperature 35.0°C Wet-bulb temperature 24.0°C

HEATING INDOOR Dry-bulb temperature 20.0°C

^{*2} When connected with below indoor units.

Outdoor model			MXZ-5E	102VA
Outdoor unit power supply		Single phase 230 V, 50 Hz		
	Indoor units number		2 to	o 5
E	Piping total length	m	Max	80
System	Connecting pipe length	m	Max	25
S	Height difference (Indoor ~ Outdoor)	m	Refer to 7 REFRIGERA	NT SYSTEM DIAGRAM.
	Height difference (Indoor ~ Indoor)	m	Refer to 7 REFRIGERA	NT SYSTEM DIAGRAM.
	Function		Cooling	Heating
	Capacity Rated frequency (MinMax.) *2	kW	10.2 (3.9 - 11.0)	10.5 (4.1 - 14.0)
	Breaker capacity	Α	2	5
	Power input (Total) *1, *2	W	3,150	2,340
ectrica data	Running current (Total) *1, *2	Α	13.8	10.3
Electrical data	Power factor (Total) *1, *2	%	99	
	Starting current (Total) *1, *2	Α	13.8	
Coeffi	cient of performance (C.O.P) (Total) * 1, * 2		3.24	4.49
ō	Model		SNB220FAGMC	
ess	Output	W	2,8	000
Compressor	Current *1, *2	Α	13.0	9.4
ပိ	Refrigeration oil (Model)	L	0.7 (F	V50S)
Fan motor	Model		E1, ET1: SIC-81FW-D888-9 / E2], ET2, ER1: SIC-88FWJ-D888-1
Fan	Current *1, *2	Α	0.	5
	Dimensions W x H x D	mm	950 x 796 x 330	
	Weight kg		6	3
_ "	Air flow (Rated)	m ³ /h	E1, ET1: 3,336 / E2, ET2, ER1: 3,906	4,080
Special	Sound level (Rated)	dB(A)	52	56
Spe	Fan speed (Rated)	rpm	E1, ET1: 620 / E2, ET2, ER1: 720	750
Refrigerant filling capacity (R410A) kg 2.99		99		

^{*1} Measured under rated operating frequency.

MSZ-EF18VE + MSZ-EF18VE + MSZ-EF22VE + MSZ-EF22VE

NOTE: Test conditions are based on ISO 5151. (Refrigerant piping length (one way): 5 m)

COOLING INDOOR Dry-bulb temperature 27.0°C Wet-bulb temperature 19.0°C

OUTDOOR Dry-bulb temperature 35.0°C Wet-bulb temperature 24.0°C

HEATING INDOOR Dry-bulb temperature 20.0°C

^{*2} When connected with below indoor units.

Outdoor model			MXZ-2E5	53VAHZ
Outdoor unit power supply		Single phase 230 V, 50 Hz		
	Indoor units number		2	
E	Piping total length	m	Max	. 30
System	Connecting pipe length	m	Max	20
S	Height difference (Indoor ~ Outdoor)	m	Refer to 7 REFRIGERAN	IT SYSTEM DIAGRAM.
	Height difference (Indoor ~ Indoor)	m	Refer to 7 REFRIGERAN	IT SYSTEM DIAGRAM.
	Function		Cooling	Heating
	Capacity Rated frequency (MinMax.) *2	kW	5.3 (1.1 - 6.0)	6.4 (1.0 - 7.0)
	Breaker capacity	Α	16/25	5 * 3
_	Power input (Total) *1, *2	W	1,290	1,360
ectrica data	Running current (Total) *1, *2	Α	5.7	6.0
Electrical data	Power factor (Total) *1, *2	%	98	
"	Starting current (Total) *1, *2	Α	6.0	
Coeffi	cient of performance (C.O.P) (Total) * 1, * 2		4.11	4.71
or	Model		SNB220FAGMC	
Compressor	Output	W	1,4	00
mpr	Current *1, *2	Α	5.3	5.5
Co	Refrigeration oil (Model)	L	0.7 (F\	/50S)
Fan motor	Model		E1: SIC-81FW-D888-9, SIC-88FWJ	-D888-1 / ER1]: SIC-88FWJ-D888-1
Fan	Current *1, *2	Α	0.:	3
	Dimensions W x H x D	mm	950 x 796 x 330	
	Weight kg		61	l
_ "	Air flow (Rated)	m ³ /h	2,820	2,820
Special	Sound level (Rated)	dB(A)	45	47
Special	Fan speed (Rated)	rpm	520	520
	Refrigerant filling capacity (R410A)	kg	2.	0

^{*1} Measured under rated operating frequency.

MSZ-EF18VE + MSZ-EF35VE

NOTE: Test conditions are based on ISO 5151. (Refrigerant piping length (one way): 5 m)

COOLING INDOOR Dry-bulb temperature 27.0°C Wet-bulb temperature 19.0°C

OUTDOOR Dry-bulb temperature 35.0°C Wet-bulb temperature 24.0°C

HEATING INDOOR Dry-bulb temperature 20.0°C

^{*2} When connected with below indoor units.

^{*3} When the amount of current exceeds the allowed value.

Outdoor model		MXZ-4E8	3VAHZ	
Outdoor unit power supply		Single phase 230 V, 50 Hz		
	Indoor units number		2 to	4
Ε	Piping total length	m	Max.	70
System	Connecting pipe length	m	Max.	25
S	Height difference (Indoor ~ Outdoor)	m	Refer to 7 REFRIGERAN	T SYSTEM DIAGRAM.
	Height difference (Indoor ~ Indoor)	m	Refer to 7 REFRIGERAN	T SYSTEM DIAGRAM.
	Function		Cooling	Heating
	Capacity Rated frequency (MinMax.) *2	kW	8.3 (3.7 - 9.2)	9.0 (3.4 - 11.6)
	Breaker capacity	Α	25/30	*3
_	Power input (Total) *1, *2	W	2,250	1,900
ectrica data	Running current (Total) *1, *2	Α	9.9	8.3
Electrical data	Power factor (Total) *1, *2	%	99	
Ш	Starting current (Total) *1, *2	Α	9.9	9
Coeffi	cient of performance (C.O.P) (Total) * 1, * 2		3.68	4.73
or	Model		MNB33FE	BTMC-L
Compressor	Output	W	1,70	00
mpr	Current *1, *2	Α	9.30	7.60
Co	Refrigeration oil (Model)	L	1.10 (F	V50S)
Fan motor	Model		SIC-81FW-D888-9, S	SIC-88FWJ-D888-1
Fan mot	Current *1, *2	Α	0.3	3
	Dimensions W x H x D	mm	950 x 1,04	18 x 330
	Weight kg		87	•
_ "	Air flow (Rated)	m ³ /h	3,780	4,620
Special	Sound level (Rated)	dB(A)	53	57
Spe	Fan speed (Rated)	rpm	650	770
	Refrigerant filling capacity (R410A)	kg	3.9	9

^{*1} Measured under rated operating frequency.

MSZ-EF18VE + MSZ-EF18VE + MSZ-EF22VE + MSZ-EF25VE

NOTE: Test conditions are based on ISO 5151. (Refrigerant piping length (one way): 5 m)

COOLING INDOOR Dry-bulb temperature 27.0 °C Wet-bulb temperature 19.0 °C

OUTDOOR Dry-bulb temperature 35.0 °C Wet-bulb temperature 24.0 °C


HEATING INDOOR Dry-bulb temperature 20.0 °C

^{*2} When connected with indoor units below.


^{*3} When the amount of current exceeds the allowed value.

OUTLINES AND DIMENSIONS


MXZ-3E54VA MXZ-3E68VA

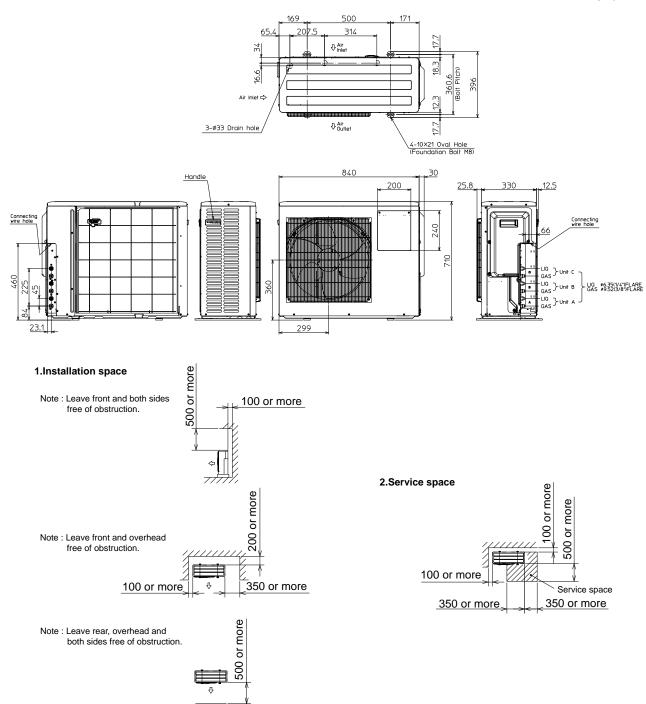


MXZ-4E72VA

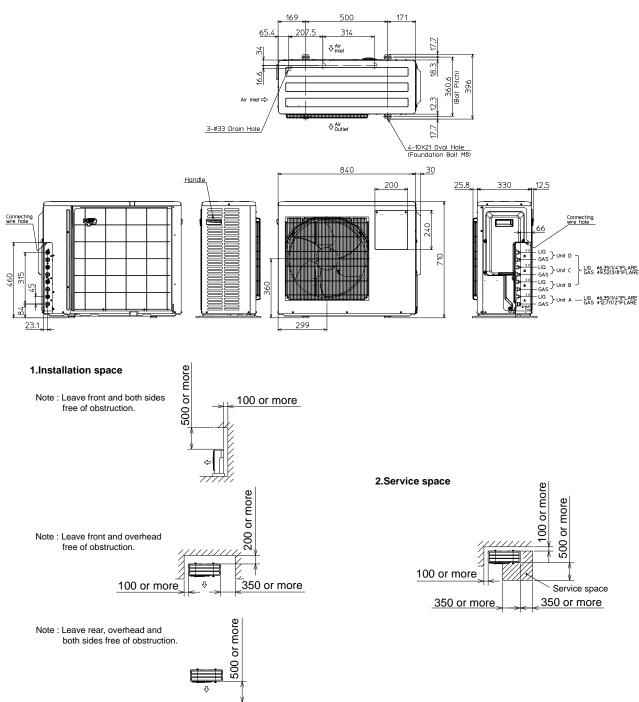


MXZ-4E83VA

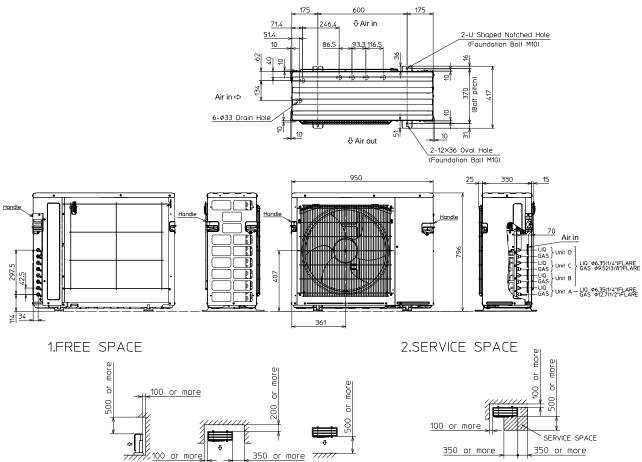



MXZ-5E102VA

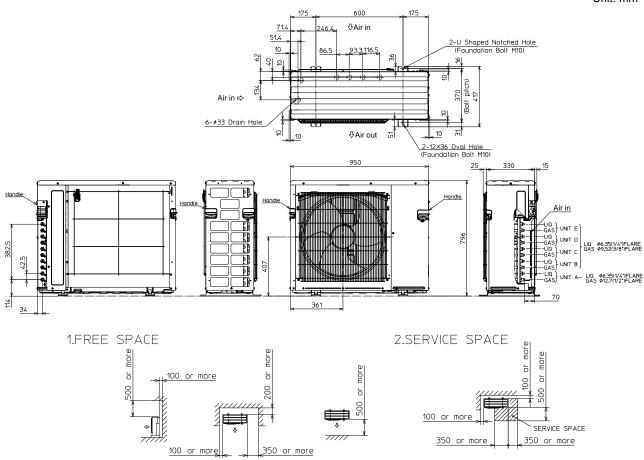


MXZ-2E53VAHZ

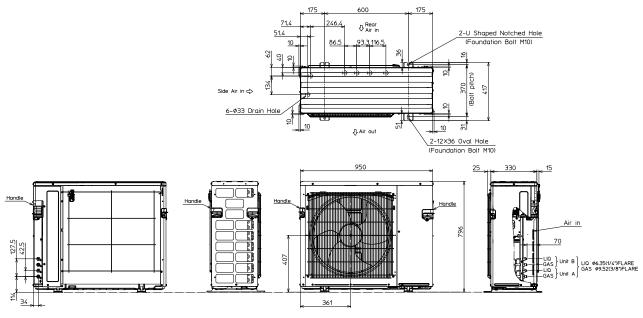






MXZ-4E83VAHZ

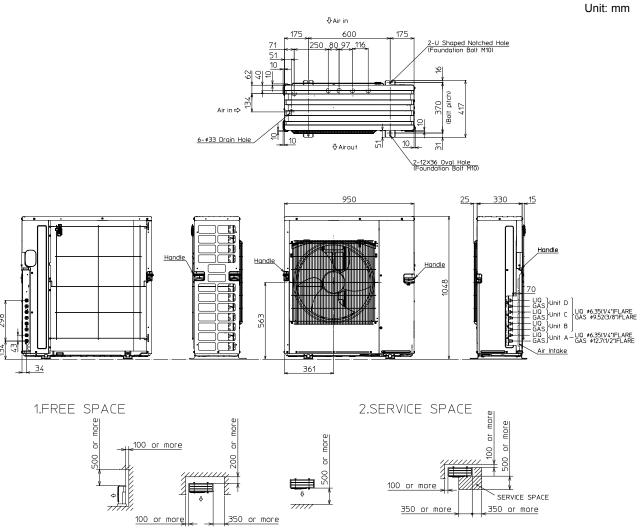

REFRIGERANT SYSTEM DIAGRAM

UNIT: mm MXZ-3E54VA

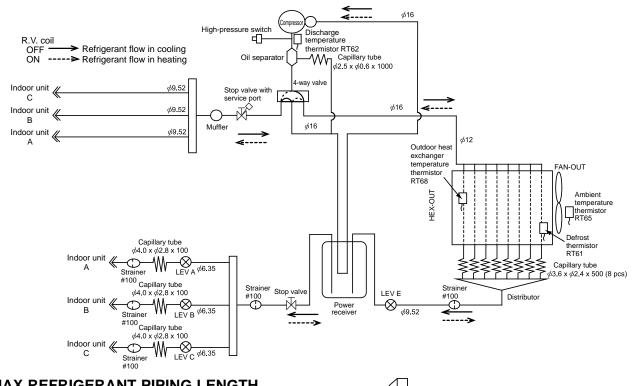

Indoor

units

MAX REFRIGERANT PIPING LENGTH

_	_
Piping length each indoor unit (a, b, c)	25 m
Total piping length (a+b+c)	50 m
Bending point for each unit	25
Total bending point	50

*It is irrelevant which unit is higher.

ADDITIONAL REFRIGERANT CHARGE

Outdoor unit precharged	Refrigerant piping length (one way, 3 unit total)				
(g)	40 m	45 m	50 m		
2,700	0	100	200		

Calculation: Xg = 20 g/m x (Refrigerant piping length (m) - 40)

WHEN CONNECTING TO MFZ-KJ SERIES INDOOR UNIT MXZ-3E54VA

No. of MFZ-KJ	Refrigerant piping le	ength (L)	Maximum amount of
indoor units	~ 40 m	~ 50 m	refrigerant
None	Charge-less (2,700 g)	(L-40) x 20 g/m	2,900 g
1 unit	100 g additional charge (2,800 g)	100 g + (L-40) x 20 g/m	3,000 g
2 units	200 g additional charge (2,900 g)	200 g + (L-40) x 20 g/m	3,100 g
3 units	300 g additional charge (3,000 g)	300 g + (L-40) x 20 g/m	3,200 g

- Refrigerant pipe diameter is different according to indoor unit to be connected. When using extension pipes, refer to the right table.
- When diameter of refrigerant pipe is different from that of outdoor unit union, use optional Different-diameter pipe. For further information on Different-diameter pipe, refer to "PARTS CATALOG".

	_			
UNI	Т:	mm	(in	ch)

Max.

Outdoor

unit


Height difference

15 m


10 m

15 m

Outdoor unit union diameter				
For				
Indoor unit A	Liquid	6.35(1/4)		
	Gas	9.52(3/8)		
Indoor unit B	Liquid	6.35(1/4)		
	Gas	9.52(3/8)		
Indoor unit C	Liquid	6.35(1/4)		
indoor unit C	Gas	9.52(3/8)		



MXZ-3E68VA UNIT: mm

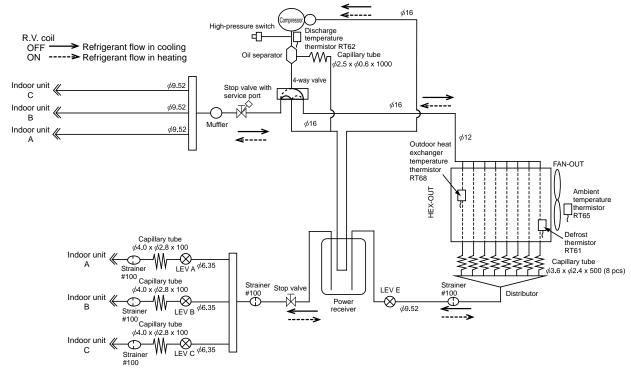

Indoor

units

MAX REFRIGERANT PIPING LENGTH

Piping length each indoor unit (a, b, c)	25 m
Total piping length (a+b+c)	60 m
Bending point for each unit	25
Total bending point	60

*It is irrelevant which unit is higher.

ADDITIONAL REFRIGERANT CHARGE

Outdoor unit precharged	Refrigerant piping length (one way, 3 unit total)			
(g)	40 m	50 m	60 m	
2,700	0	200	400	

Calculation : Xg = 20 g/m x (Refrigerant piping length (m) - 40)

WHEN CONNECTING TO MFZ-KJ SERIES INDOOR UNIT MXZ-3E68VA

No. of MFZ-KJ	Refrigerant piping le	Maximum amount of	
indoor units	~ 40 m	~ 60 m	refrigerant
None	Charge-less (2,700 g)	(L-40) x 20 g/m	3,100 g
1 unit	100 g additional charge (2,800 g)	100 g + (L-40) x 20 g/m	3,200 g
2 units	200 g additional charge (2,900 g)	200 g + (L-40) x 20 g/m	3,300 g
3 units	300 g additional charge (3,000 g)	300 g + (L-40) x 20 g/m	3,400 g

- Refrigerant pipe diameter is different according to indoor unit to be connected. When using extension pipes, refer to the right table.
- When diameter of refrigerant pipe is different from that of outdoor unit union, use optional Different-diameter pipe.
 For further information on Different-diameter pipe, refer to "PARTS CATALOG".

UNIT: mm (inch)

Max.

Outdoor

unit

Height difference


15 m

10 m

15 m

Outdoor unit union diameter				
For				
Indoor unit A	Liquid	6.35(1/4)		
	Gas	9.52(3/8)		
Indoor unit B	Liquid	6.35(1/4)		
	Gas	9.52(3/8)		
Indoor unit C	Liquid	6.35(1/4)		
indoor unit C	Gas	9.52(3/8)		

UNIT: mm MXZ-4E72VA

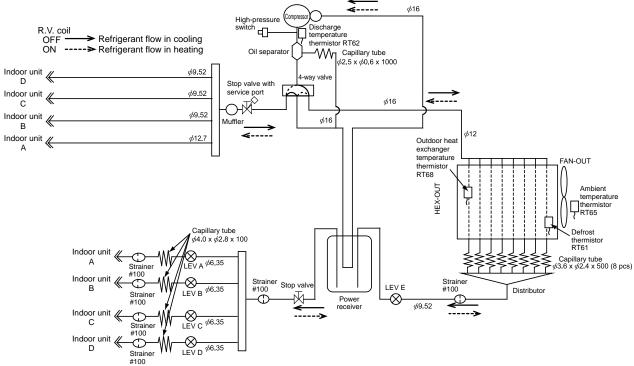

Indoor units

MAX REFRIGERANT PIPING LENGTH

Piping length each indoor unit (a, b, c, d)	25 m
Total piping length (a+b+c+d)	60 m
Bending point for each unit	25
Total bending point	60

*It is irrelevant which unit is higher.

ADDITIONAL REFRIGERANT CHARGE

Outdoor unit precharged (g)				
	40 m	50 m	60 m	
2,700	0	200	400	

Calculation: Xg = 20 g/m x (Refrigerant piping length (m) - 40)

WHEN CONNECTING TO MFZ-KJ SERIES INDOOR UNIT MXZ-4E72VA

No. of MFZ-KJ	Refrigerant piping l	Maximum amount of	
indoor units	~ 40 m	~ 60 m	refrigerant
None	Charge-less (2,700 g)	(L-40) x 20 g/m	3,100 g
1 unit	100 g additional charge (2,800 g)	100 g + (L-40) x 20 g/m	3,200 g
2 units	200 g additional charge (2,900 g)	200 g + (L-40) x 20 g/m	3,300 g
3 units	300 g additional charge (3,000 g)	300 g + (L-40) x 20 g/m	3,400 g
4 units	400 g additional charge (3,100 g)	400 g + (L-40) x 20 g/m	3,500 g

- Refrigerant pipe diameter is different according to indoor unit to be connected. When using extension pipes, refer to the right table.
- When diameter of refrigerant pipe is different from that of outdoor unit union, use optional Different-diameter pipe. For further information on Different-diameter pipe, refer to "PARTS CATALOG".

UNIT:	mm	(incl	h)
-------	----	-------	----

Max. Height difference

15 m

10 m


15 m

Outdoor unit

Outdoor unit union diameter			
For			
Indoor unit A	Liquid	6.35(1/4)	
Indoor unit A	Gas	12.7(1/2)	
la de en coit D	Liquid	6.35(1/4)	
Indoor unit B	Gas	9.52(3/8)	
Indoor unit C	Liquid	6.35(1/4)	
Indoor unit C	Gas	9.52(3/8)	
la de en cost D	Liquid	6.35(1/4)	
Indoor unit D	Gas	9.52(3/8)	



MXZ-4E83VA UNIT: mm

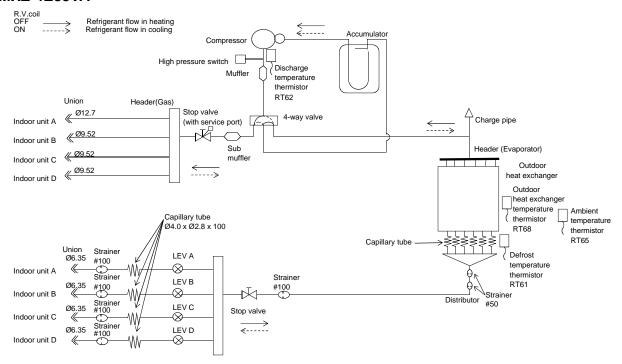

MAX REFRIGERANT PIPING LENGTH


Piping length each indoor unit (a, b, c, d)	25 m
Total piping length (a+b+c+d)	70 m
Bending point for each unit	25
Total bending point	70

*It is irrelevant which unit is higher.

ADDITIONAL REFRIGERANT CHARGE

Outdoor unit precharged	Refriger	ant piping leng	th (one way, 4	unit total)				
(g)	25 m	25 m 40 m 55 m 70 m						
2,990	0	300	600	900				

Calculation : Xg = 20 g/m x (Refrigerant piping length (m) - 25)




- Refrigerant pipe diameter is different according to indoor unit to be connected. When using extension pipes, refer to the tables below.
- When diameter of refrigerant pipe is different from that of outdoor unit union, use optional Different-diameter pipe.
 For further information on Different-diameter pipe, refer to "PARTS CATALOG".

UNIT: mm (inch)

		• •		
Outdoor unit union diameter				
For				
Indoor unit A	Liquid	6.35(1/4)		
	Gas	12.7(1/2)		
Indoor unit B	Liquid	6.35(1/4)		
	Gas	9.52(3/8)		
Indoor unit C	Liquid	6.35(1/4)		
Indoor unit C	Gas	9.52(3/8)		
Ladam el D	Liquid	6.35(1/4)		
Indoor unit D	Gas	9.52(3/8)		



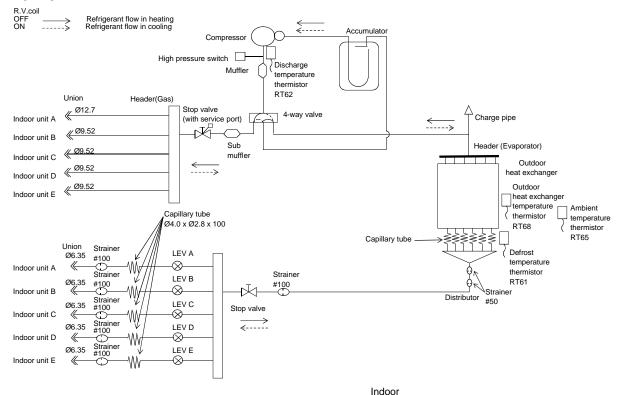

MAX REFRIGERANT PIPING LENGTH


Piping length each indoor unit (a, b, c, d,e)	25 m
Total piping length (a+b+c+d+e)	80 m
Bending point for each unit	25
Total bending point	80

*It is irrelevant which unit is higher.

ADDITIONAL REFRIGERANT CHARGE

Outdoor unit precharged	Refri	Refrigerant piping length (one way, 5 unit total)				
(g)						
2,990	0	400	800	1,200	1,600	

Calculation : Xg = 20 g/m x (Refrigerant piping length (m) - 0)




- Refrigerant pipe diameter is different according to indoor unit to be connected. When using extension pipes, refer to the tables below.
- When diameter of refrigerant pipe is different from that of outdoor unit union, use optional Different-diameter pipe.
 For further information on Different-diameter pipe, refer to "PARTS CATALOG".

UNIT: mm (inch)

· · · · · · · · · · · · · · · · · · ·				
Outdoor unit union diameter				
For				
Indoor unit A	Liquid	6.35(1/4)		
Indoor unit A	Gas	12.7(1/2)		
Indoor unit D	Liquid	6.35(1/4)		
Indoor unit B	Gas	9.52(3/8)		
Indoor unit C	Liquid	6.35(1/4)		
indoor unit C	Gas	9.52(3/8)		
Indoor unit D	Liquid	6.35(1/4)		
IIIdooi dilit D	Gas	9.52(3/8)		
Indoor unit E	Liquid	6.35(1/4)		
IIIuuui uiil E	Gas	9.52(3/8)		

MXZ-2E53VAHZ UNIT: mm

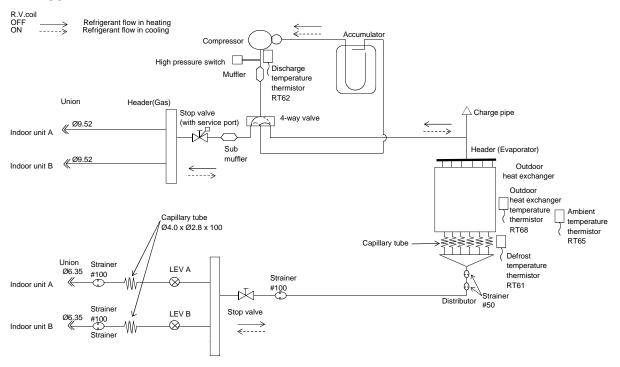

MAX REFRIGERANT PIPING LENGTH


Piping length each indoor unit (a, b)	20 m
Total piping length (a+b)	30 m
Bending point for each unit	20
Total bending point	30

*It is irrelevant which unit is higher.

ADDITIONAL REFRIGERANT CHARGE

Outdoor unit precharged	Refrigerant p	piping length (one way, 2 unit total)		
(g)	20 m	25 m	30 m	
2,000	0	100	200	

Calculation: Xg = 20 g/m x (Refrigerant piping length (m) - 20)




- Refrigerant pipe diameter is different according to indoor unit to be connected. When using extension pipes, refer to the tables below.
- When diameter of refrigerant pipe is different from that of outdoor unit union, use optional Different-diameter pipe.
 For further information on Different-diameter pipe, refer to "PARTS CATALOG".

UNIT: mm (inch)

Outdoor unit union diameter				
For				
Indoor unit A	Liquid	6.35(1/4)		
	Gas	9.52(3/8)		
Indoor wait D	Liquid	6.35(1/4)		
Indoor unit B	Gas	9.52(3/8)		

MXZ-4E83VAHZ UNIT: mm

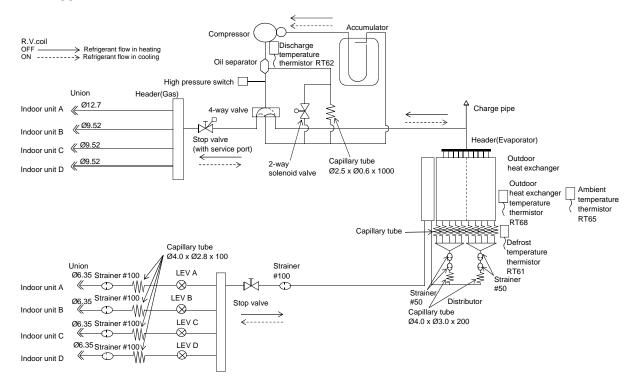

MAX REFRIGERANT PIPING LENGTH


Piping length each indoor unit (a, b, c, d)	25 m
Total piping length (a+b+c+d)	70 m
Bending point for each unit	25
Total bending point	70

*It is irrelevant which unit is higher.

ADDITIONAL REFRIGERANT CHARGE

Outdoor unit precharged	Refrigera	ant piping leng	th (one way, 4	unit total)		
(g)	25 m 40 m 55 m 70 m					
3,900	0	300	600	900		

Calculation: Xg = 20 g/m x (Refrigerant piping length (m) - 25)



- Refrigerant pipe diameter is different according to indoor unit to be connected. When using extension pipes, refer to the tables below.
- When diameter of refrigerant pipe is different from that of outdoor unit union, use optional Different-diameter pipe.
 For further information on Different-diameter pipe, refer to "PARTS CATALOG".

UNIT: mm (inch)

Outdoor unit union diameter				
For]			
Indoor unit A	Liquid	6.35(1/4)		
illuool uliit A	Gas	12.7(1/2)		
Indoor unit B	Liquid	6.35(1/4)		
IIIuuu uiii b	Gas	9.52(3/8)		
Indoor unit C	Liquid	6.35(1/4)		
indoor drift C	Gas	9.52(3/8)		
Indoor unit D	Liquid	6.35(1/4)		
IIIdoor driit D	Gas	9.52(3/8)		

PUMPING DOWN

When relocating or disposing of the air conditioner, pump down the system following the procedure below so that no refrigerant is released into the atmosphere.

- 1) Turn off the breaker.
- 2) Connect the gauge manifold valve to the service port of the stop valve on the gas pipe side of the outdoor unit.
- 3) Fully close the stop valve on the liquid pipe side of the outdoor unit.
- 4) Turn on the breaker.
- 5) Start the emergency COOL operation on all the indoor units.
- 6) When the pressure gauge shows 0.05 to 0 MPa [Gauge] (approximately 0.5 to 0 kgf/cm²), fully close the stop valve on the gas pipe side of the outdoor unit and stop the operation. (Refer to the indoor unit installation manual about the method for stopping the operation.)
 - * If too much refrigerant has been added to the air conditioner system, the pressure may not drop to 0.05 to 0 MPa [Gauge] (approximately 0.5 to 0 kgf/cm²), or the protection function may operate due to the pressure increase in the high-pressure refrigerant circuit. If this occurs, use a refrigerant collecting device to collect all of the refrigerant in the system, and then recharge the system with the correct amount of refrigerant after the indoor and outdoor units have been relocated.
- 7) Turn off the breaker. Remove the pressure gauge and the refrigerant piping.

WARNING

When pumping down the refrigerant, stop the compressor before disconnecting the refrigerant pipes. The compressor may burst and cause injury if any foreign substance, such as air, enters the pipes.

9

ACTUATOR CONTROL

MXZ-3E54VA MXZ-3E68VA MXZ-4E72VA MXZ-4E83VA MXZ-5E102VA MXZ-2E53VAHZ MXZ-4E83VAHZ

Relation between main sensor and actuator

				Actu	ator		
Sensor	Purpose	Compres- sor	LEV	Outdoor fan motor	4-way valve	2-way solenoid valve *1	Defrost heater *2
Discharge temperature thermistor	Protection	0	0			0	
Indoor coil	Cooling: Coil frost prevention	0				0	
temperature thermistor	Heating: High pressure protection	0	0				
Defrost thermistor	Heating: Defrosting	0	0	0	0		
Fin temperature thermistor	Protection	0		0			
Ambient temperature	Control/Protection	0	0	0		0	
thermistor	Heating: Defrosting (Heater)						0
Outdoor heat exchanger temperature thermistor	Cooling: Control/Protection	0	0	0		0	
Capacity code	Control	0	0				

^{*1} MXZ-4E83VAHZ

^{*2} MXZ-2E53VAHZ, 4E83VAHZ

SERVICE FUNCTIONS

MXZ-3E54VA MXZ-3E68VA MXZ-4E72VA MXZ-4E83VA MXZ-5E102VA MXZ-2E53VAHZ MXZ-4E83VAHZ

10-1. PRE-HEAT CONTROL

If moisture gets into the refrigerant cycle, or when refrigerant is liquefied and collected in the compressor, it may interfere the start-up of the compressor.

To improve start-up condition, the compressor is energized even while it is not operating.


This is to generate heat at the winding.

The compressor uses about 50 W when pre-heat control is turned ON.

Pre-heat control is ON at initial setting.

[How to deactivate pre-heat control]

- ① Turn OFF the power supply for the air conditioner before making the setting.
- ② Set the "4" of SW2 on the outdoor control P.C. board to ON to deactivate pre-heat control function.

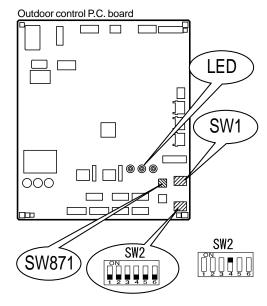

3 Turn ON the power supply for the air conditioner.

NOTE: Pre-heat control will be turned OFF when the breaker is turned OFF.

10-2. LOCKING THE OPERATION MODE OF THE AIR CONDITIONER (COOL, DRY, HEAT) (MXZ-4E83VAHZ)

With this function, you can lock the operation mode of the outdoor unit.


Once the operation mode is locked to either COOL/DRY mode or HEAT mode, the air conditioner operates in that mode only.

Default setting is required to activate this function.

Please explain about this function to your customers and ask them whether they want to use it.

[How to lock the operation mode]

- (1) Turn OFF the power supply and make sure that the LED goes off.
- (2) Set SW1 on the outdoor control P.C. board.
- (3) Turn ON the power supply.





10-3. LOWERING THE OPERATING NOISE OF THE OUTDOOR UNIT (MXZ-4E83VAHZ)

With this function, you can lower the operating noise of the outdoor unit when the operation load is small, for example, during night time in COOL mode.


However, note that the cooling and heating capacity can also be lowered if this function is activated.

Default setting is required to activate this function.

Please explain about this function to your customers and ask them whether they want to use it.

[How to lower the operating noise]

- (1) Turn OFF the power supply and make sure that the LED goes off.
- (2) Set the "5" Switch of SW1 on the outdoor control P.C. board to ON to enable this function.
- (3) Turn ON the power supply.



10-4. AUTO LINE CORRECTING

Outdoor unit has an auto line correcting function which automatically detects and corrects improper wiring or piping.

Improper wiring or piping can be automatically detected by pressing the piping/wiring correction switch (SW871). When improper wiring or piping is detected, wiring lines are corrected.

This will be completed in about 10 to 20 minutes.

[How to activate this function]

- 1. Check that outside temperature is above 0°C.
 - (This function does not work when outside temperature is not above 0°C.)
- 2. Check that the stop valves of the liquid pipe and gas pipe are open.
- 3. Check that the wiring between indoor and outdoor unit is correct.
 - (If the wiring is not correct, this function does not work.)
- 4. Turn ON the power supply and wait at least 1 minute.
- Press the piping/wiring correction switch (SW871) on the outdoor control P.C. board. Do not touch energized parts.

LED indication during detection:

LED1 (Red)	LED2 (Yellow)	LED3 (Green)	
Lighted	Lighted	Once	

LED indication after detection:

LED1 (Red) LED2 (Yellow) LED3 (Green)		LED3 (Green)	Indication
Lighted Not lighted Lighted		Lighted	Completed (Problem corrected/ normal)
Once Once Once		Once	Not completed (Detection failed)
			Refer to "SAFETY PRECAUTIONS WHEN LED FLASHES" located behind the service panel.

^{*} Make sure that the valves are open and the pipes are not collapsed or clogged.

6. Press the switch to cancel.

LED indication after cancel:

LED1 (Red)	LED2 (Yellow)	LED3 (Green)
Lighted	Lighted	Not lighted

NOTE: Indoor unit cannot be operated while this function is activated.

When this function is activated while indoor unit is operating, the operation will be stopped.

Operate indoor unit after the auto line correcting is finished.

Pressing the switch during detection cancels this function.

The record of auto line correcting can be confirmed in the following way:

Press the switch for more than 5 seconds.

LED will show the record of auto correcting for about 30 seconds as shown in the table below:

	Wiring line		
LED1 (Red)	LED2 (Yellow)	LED3 (Green)	Wiring line
Once	Once	Lighted	Not corrected
3 times	3 times	Lighted	Corrected

NOTE: Activate this function to confirm the correct wiring after replacing the outdoor control P.C. board.

(Previous records are deleted when the outdoor control P.C. board is replaced.)

The record cannot be shown if auto line correcting is not canceled (Refer to "How to activate this function").

10-5. CHANGING THE AMPERE LIMIT (MXZ-2E53VAHZ MXZ-4E83VAHZ)

With this function, the amount of current that flows in the outdoor unit can be changed.

NOTE: Use this function only when the amount of current exceeds the allowed value.

[How to change the ampere limit]

- (1) Be sure to turn off the main power for the air conditioner before making the setting.
- (2) Make the setting referring to the table below.
- (3) Turn ON the power supply.

SW2 on the outdoor control P.C. board

SW2	MXZ-2E53VAHZ	MXZ-4E83VAHZ		
ON	Factory setting 13.6 A	21 A		
ON	18.4 A	Factory setting 25 A		

11

TROUBLESHOOTING


MXZ-3E54VA MXZ-3E68VA MXZ-4E72VA MXZ-4E83VA MXZ-5E102VA MXZ-2E53VAHZ MXZ-4E83VAHZ

11-1. CAUTIONS ON TROUBLESHOOTING

- 1. Before troubleshooting, check the following:
 - 1) Check the power supply voltage.
 - 2) Check the indoor/outdoor connecting wire for miswiring.

2. Take care of the following during servicing

- 1) Before servicing the air conditioner, be sure to turn OFF the unit first with the remote controller, and after confirming the horizontal vane is closed, turn OFF the breaker and/or disconnect the power plug.
- 2) Be sure to turn OFF the power supply before removing the front panel, the cabinet, the top panel, and the P.C. board.
- 3) When removing the electrical parts, be careful of the residual voltage of smoothing capacitor.
- 4) When removing the P.C. board, hold the edge of the board with care NOT to apply stress on the components.
- 5) When connecting or disconnecting the connectors, hold the connector housing. DO NOT pull the lead wires.



3. Troubleshooting procedure

- Check if the OPERATION INDICATOR lamp on the indoor unit is flashing on and off to indicate an abnormality. To
 make sure, check how many times the OPERATION INDICATOR lamp is flashing on and off before starting service
 work.
- 2) Before servicing, check that the connector and terminal are connected properly.
- When the P.C. board seems to be defective, check the copper foil pattern for disconnection and the components for bursting and discoloration.
- 4) Refer to 11-2, 11-3 and 11-4.

11-2. FAILURE MODE RECALL FUNCTION

This air conditioner can memorize the abnormal condition which has occurred once.

Even though LED indication listed on the troubleshooting check table (11-4.) disappears, the memorized failure details can be recalled.

1. Flow chart of failure mode recall function for the indoor/outdoor unit

Refer to the service manual of indoor unit.

2. Flow chart of the detailed outdoor unit failure mode recall function

Operational procedure The outdoor unit might be abnormal. Check if outdoor unit is abnormal according to the following procedures. %1 Regardless of normal or abnormal condition, 2 short Make sure that the remote controller is set to the failure mode recall function. beeps are emitted as the signal is received. ***3** *3 Refer to the service manual of indoor unit. With the remote controller headed towards the indoor unit, press the TEMPERATURE buttons to adjust the set temperature to 25°C. %1 Does the OPERATION INDICATOR lamp on the indoor unit blink at the interval of 0.5 seconds? Blinks: The outdoor unit is abnormal. Beep is emitted at the same timing as the blinking of the OPERATION INDICATOR lamp. $\mbox{\%}2$ (OFF) Yes (Blinks) The outdoor unit is abnormal. The outdoor unit is normal. Check the blinking pattern, and make sure that the abnormal point with the outdoor unit failure mode table (11-2.3.). Make sure to check at least 2 consecutive blinking cycles. **2 Release the failure mode recall function. $\mbox{\em \times}3$ Release the failure mode recall function. 3%3 Repair the failure parts. Delete the memorized abnormal condition. 33 Release the failure mode recall function. *3

- NOTE: 1. Make sure to release the failure mode recall function after it is set up, otherwise the unit cannot operate properly.
 - 2. If the abnormal condition is not deleted from the memory, the last abnormal condition is kept memorized.

 $\ensuremath{\%2.Blinking}$ pattern when outdoor unit is abnormal:



3. Outdoor unit failure mode table


The left lamp of OPERATION DICATOR lamp (Indoor unit)	or O
2-time flash Outdoor power system Lighted Lighted Lighted Lighted Concernment protection cut-out operates 3 consecutive times within 1 minute after the compressor connecting wire. Refer to 11-6. @ "Check the connection of the consecutive times within 3 minutes after the compressor connection wire pressor connection wire pressor connection within 3 minutes after the compressor or control operates 3 consecutive times within 3 minutes after the compressor connection cut-out operates 3 consecutive times within 3 minutes after the compressor connection cut-out operates 3 consecutive times within 3 minutes after the compressor connection cut-out operates 3 consecutive times within 3 minutes after the compressor connection cut-out operates 3 consecutive times within 3 minutes after the compressor connection cut-out operates 3 consecutive times within 3 minutes after the compressor connection of the consecutive times within 3 minutes after the compressor connection cut-out operates 3 consecutive times within 3 minutes after the compressor connection operation.	or O
2-time flash Outdoor power system Lighted Lighted Lighted Conceutrement protection cut-out operates 3 consecutive times within 1 minute after the compressor connection without operates 3 consecutive times within 3 minutes	or O
Defrost thermistor Lighted Once Ambient temperature thermistor Lighted Twice Fin temperature thermistor Lighted Stimes P.C. board temperature thermiss Lighted Stimes P.C. board temperature thermiss Lighted Stimes P.C. board temperature thermiss Lighted Stimes P.C. board temperature thermistor Lighted Stimes P.C. board temperature thermistor Lighted Stimes P.C. board temperature Lighted Stimes P.C. board temperature Lighted Stimes P.C. board temperature Lighted P.C. board temperature Lighted Li	or or —
Ambient temperature thermistor Fin temperature thermistor P.C. board temperature thermistor Outdoor heat exchanger temperature hermistor 4-time flash Overcurrent Once Stighted Overcurrent Once Stighted Uighted Uig	or
Ambient temperature thermistor Fin temperature thermistor P.C. board temperature thermistor Outdoor heat exchanger temperature thermistor 4-time flash Overcurrent Once Uighted Uighte	or
Fin temperature thermistor P.C. board temperature thermis- tor Outdoor heat exchanger temperature hermistor 4-time flash Overcurrent Once Dighted Overcurrent Once Lighted Uighted 5-time flash Discharge temperature Lighted Lighted Lighted Lighted Lighted Lighted Lighted Lighted Lighte	or
P.C. board temperature thermistor P.C. board temperature thermistor	or
Outdoor heat exchanger temperature thermistor	n
Setime flash Discharge temperature Lighted Light	n
Check of LEV".	
ceeds 70°C during cooling or the indoor gas pipe temperature exceeds 70°C during heating. 7-time flash Fin temperature 3 times Not lighted P.C. board temperature 4 times Not lighted P.C. board temperature 4 times Lighted Value: A times Vot lighted Value: A times V	_
Setime flash	-
lighted lighted (MXZ-3E54/3E68/4E72/4E83/5E102VA, MXZ-2E52VAHZ)/87°C (MXZ-4E83VAHZ) during operation. S-time flash Outdoor fan motor Lighted Lighted Lighted Lighted seconds after the fan gets started. • Refer to 11-6. © "Check of outdoor fan motor".	_
seconds after the fan gets started. fan motor".	ır
9-time flash Outdoor control system Lighted 5 times Nonvolatile memory data cannot be read prop- • Replace the outdoor control P.C. boa	_
erly.	0
10-time flash Low discharge temperature protection Lighted Lighted Lighted or more and the discharge temperature is kept Check refrigerant circuit and refrormore and the discharge temperature is kept Check refrigerant circuit and refrormore and the discharge temperature is kept Check refrigerant circuit and refrormore and the discharge temperature is kept Check refrigerant circuit and refrormore and the discharge temperature is kept Check refrigerant circuit and refrormore and the discharge temperature is kept Check refrigerant circuit and refrormore and the discharge temperature is kept Check refrigerant circuit and refrormore and the discharge temperature is kept Check refrigerant circuit and refrormore and the discharge temperature is kept Check refrigerant circuit and refrormore and the discharge temperature is kept Check refrigerant circuit and refrormore and the discharge temperature is kept Check refrigerant circuit and refrormore and the discharge temperature is kept Check refrigerant circuit and refrormore and the discharge temperature is kept Check refrigerant circuit and refrormore and the discharge temperature is kept Check refrigerant circuit and refrormore and the discharge temperature is kept Check refrigerant circuit and refrormore and the discharge temperature is kept Check refrigerant circuit and refrormore and the discharge temperature is kept Check refrigerant circuit and refrormore and the discharge temperature is kept Check refrigerant circuit and refrormore and the discharge temperature is kept Check refrigerant circuit and refrormore and the discharge temperature is kept Check refrigerant circuit and refrormore and r	
11-time flash Communication error between P.C. boards Lighted between P.C. boards Communication error occurs between the outdoor control P.C. board and outdoor power P.C. board for more than 10 seconds. The communication error occurs between the outdoor control P.C. board and o	
tion cut-out operates 2 consecutive times.	0
Current sensor Lighted 7 times A short or open circuit is detected in the current sensor during compressor operating.	_
Current sensor protection cut-out operates 2 consecutive times.	0
Zero cross detecting circuit 5 times Not lighted The protection cut-out of the zero cross detected while the compressor is operating. The protection cut-out of the zero cross detecting circuit operates 10 consecutive times. * Check the connecting wire amo outdoor control P.C. board and or door power P.C. board.	
Converter 5 times Not lighted converter during operation. A failure is detected in the operation of the converter during operation. • Check the voltage of power supple Replace the outdoor power P. board.	
Bus-bar voltage 5 times Not lighted Sus-bar voltage exceeds 400 V or falls to low level during compressor operating. • Check the voltage of power supplemental to the control P. • Replace the outdoor control P. • Rep	
15-time flash LEV and drain pump Lighted Lighted The indoor unit detects an abnormality in the LEV and drain pump. • Refer to 11-6. © "Check of LEV". • Check the drain pump of the indounit.	

NOTE: Blinking patterns of this mode differ from the ones of Troubleshooting check table (11-4.).

11-3. INSTRUCTION OF TROUBLESHOOTING

• Check the indoor unit with referring to the indoor unit service manual, and confirm that there is any problem in the indoor unit.

Then, check the outdoor unit with referring to this page.

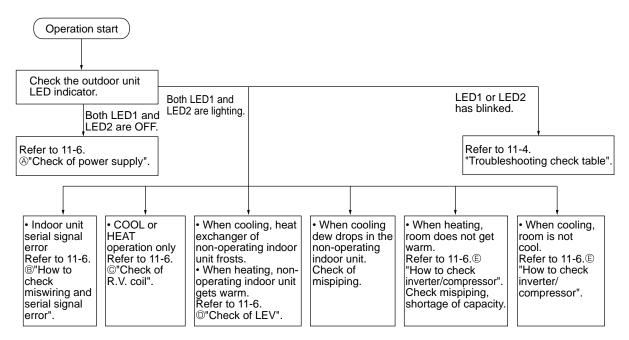

11-4. TROUBLESHOOTING CHECK TABLE

Continue				cation	Abnormal point / Con-		
Second contents Co	No.	, ,			•	Condition	, in the second
Second Company Seco		unit does	Lighted	Once	LEV and drain pump	and drain pump.	Check the drain pump of the indoor unit.
Eighted Sames Department of the mistor after 1 of mistors and personal as detected in the themstore start-up. Refer to 11-6.0° Check of outdoor thermstore 1 mistor after 1 of mistors after upon 1 mistors after 1 of mistors after 2 of mistors after 3 of mistors after 2 of mistors after 3 of	2	not operate.	Lighted	Twice		tive times within 1 minute after the compressor gets started, or converter protection cut-out or bus- bar voltage protection cut-out operates 3 consecu-	ing wire. • Refer to 11-6. © "How to check inverter/compressor".
Lighted 4 times Hemistor A short or open circuit is detected in the thermistor A short or open circuit is detected in the thermistor A short or open circuit is detected in the thermistor A short or open circuit is detected in the thermistor during operation. A short or open circuit is detected in the thermistor during operation. A short or open circuit is detected in the thermistor during operation. A short or open circuit is detected in the thermistor during operation. A short or open circuit is detected in the thermistor during operation. A short or open circuit is detected in the thermistor. A short or open circuit is detected. A short	3		Lighted	3 times		operation, or an open circuit is detected in the ther-	• Refer to 11-6. "Check of outdoor thermistors".
Separate the outdoor control P.C. Doard	4		Lighted	4 times	thermistor		
Lighted Stimes Lighted Lighted Stimes Lighted Lighted	_				ture thermistor	<u> </u>	Replace the outdoor control P.C. board.
Lighted Stimes Defrest termination D	5				thermistor	during operation.	
Defrost thermistory operation, or an open circuit is detected in the file-incomposition of compressor start-up.			Lighted	5 times	changer temperature	operation, or an open circuit is detected in the thermistor after 5 minutes (in cooling) and 10 minutes (in heating) of compressor start-up.	Refer to 11-6. "Check of outdoor thermistors".
Lighted 6 times Current sensor Current sensor Current sensor protection cut-out operates 2 consecutive times. Replace the outdoor control P.C. board Replace the outdoor power P.C. board.					Defrost thermistor	operation, or an open circuit is detected in the ther-	
Lighted 8 times Current sensor protection cut-out operates 2 consecutive times. Current sensor protection cut-out between C. board. Lighted 11 times Lighted 12 times Lighted 12 times Lighted 12 times Lighted 13 times Lighted 14 times Lighted 15 times Relay operation. Lighted 15 times Relay operation. Lighted 16 times Relay operation. Lighted 17 times Relay operation. Lighted 18 times Relay operation. Lighted 19 times Relay operation. Lighted 10 times Relay operation. Lock protection of times relay times times and treating operation. Lock protection of times relay times times and times ti			Lighted	6 times	circuit (Outdoor control	-	Replace the outdoor control P.C. board.
Lighted 11 times Lighted 11 times Lighted 12 times Lighted 13 times Lighted 13 times Lighted 13 times Lighted 14 times Lighted 15 times Lighted 15 times Lighted 15 times Not lighted	7		Lighted	7 times	Outdoor control system		Replace the outdoor control P.C. board.
Lighted 11 times	8		Lighted	8 times	Current sensor		Replace the outdoor power P.C. board.
Mexical communication errors P.C. board and outdoor control P.C. board and outdoor control P.C. board, or terminal block.	9						
Lighted 12 times			Lighted	11 times			adapter P.C. board and outdoor control P.C.
Lighted	10		Lighted	12 times	circuit (Outdoor power		Replace the outdoor power P.C. board.
Lighted 14 times Votrage sensor age detection circuit during operation. Neplace the outdoor power P.C. board.	11		Lighted	13 times	Current sensor		Replace the outdoor power P.C. board.
14 Outdoor unit stops and restarts 3 minutes later is repeated. 17 10 10 10 10 10 10 10	12		Lighted	14 times	Voltage sensor		Replace the outdoor power P.C. board.
stops and restarts 3 minutes later is prepared. Twice Not lighted Not lighted	<u> </u>		Lighted	15 times	Relay operation	No relay operation is detected during operation.	Replace the outdoor power P.C. board.
Stimes Not lighted Not lighted Stimes Stimes Not lighted Stimes Not lighted Stimes Not lighted Stimes Stimes Not lighted Stimes Stimes Not lighted Stimes Stimes Not lighted Stimes Not lighted Stimes Not lighted Stimes Stimes Stimes Not lighted Stimes Not lighted Stimes Stimes Stimes Not lighted Stimes S	14	stops and restarts	Twice	Not lighted	IPM protection	pressor start-up.	Refer to 11-6. © "How to check inverter/ compressor".
The discharge temperature process of 15°C (MXZ-3E3/3E69(42TVAV) 106°C (MXZ-4E33/3E102VA, MXZ-3E54/3E69(42TVAV) 106°C (MXZ-4E33/3E102VA, Operation.) The discharge temperature protection operation. Discharge temperature themistor reads 80°C (MXZ-3E34/3E68/4E72VAV) 95°C (MXZ-4E34/3E68/4E72VAV) 95°C (MXZ-4E34/3E68/4T24VAV) 95°C (MXZ-4E34/3E68/4T24VAV) 95°C (MXZ-4E34/3E68/4T24VAV) 95°C (MXZ-4E		later' is			Lock protection		
A times Not lighted P.C. board temperature protection The P.C. board temperature exceeds during operation. -Check refrigerant circuit and refrigerant amount. -Refer to 11-6. Check of outdoor fan motor". -Check around of gas and the refrigerant circuit. -Check the stop valve.	15	ropodiod.	3 times	Not lighted		3E54/3E68/ĂE72VÅ)/ 106°C(MXZ-4E83/5E102VA, MXZ-2E52VAHZ)/ 116°C (MXZ-4E83VAHZ) during operation. Compressor can restart if discharge temperature thermistor reads 80°C (MXZ-3E54/3E68/4E72VA)/ 95°C (MXZ-4E83/5E102VA, MXZ-2E52VAHZ)/	
protection tion. 17	16		4 times	Not lighted	protection		
Stimes Not lighted High-pressure protection High-pressure protection Switch (HPS) during operation. The outdoor heat exchanger temperature exceeds 70°C during cooling or the indoor gas pipe temperature exceeds 70°C during heating. Check the stop valve.						tion.	THE IN THE OF WHECK OF OUTGOOF FAIR MOTOF".
18 18 19 19 10 10	17		5 times	Not lighted		switch (HPS) during operation. The outdoor heat exchanger temperature exceeds 70°C during cooling or the indoor gas pipe tem-	
9 times Not lighted Converter protection er during operation. 1 **Replace the outdoor power P.C. board.* 1 **Check the voltage of power supply.* 1 **Check the voltage of power supply.* 1 **Replace the outdoor power P.C. board.* 1 **Check the voltage of power supply.* 1 **Replace the outdoor power P.C. board or the outdoor control P.C. board.* 1 **Replace the outdoor power P.C. board or the outdoor control P.C. board.* 1 **Replace the outdoor power P.C. board.* 1 **Replace the outdoor power P.C. board.* 2 **Replace the outdoor power P.C. board.* 2 **Replace the outdoor power P.C. board.* 3 **Replace the outdoor power P.C. board.* 4 **Replace the outdoor power P.C. board.* 4 **Replace the outdoor power P.C. board.* 5 **Replace the outdoor power P.C. board.* 5 **Replace the outdoor power P.C. board.* 6 **Replace the outdoor power P.C. board.* 6 **Replace the outdoor power P.C. board.* 6 **Replace the outdoor power P.C. board.* 7 **Replace the outdoor power P.C. board.* 8 **Replace the outdoor power P.C. board.* 9 **Replace the outdoor power P.C. board.* 1 **Replace the outdoor power P.C. board.* 2 **Replace the outdoor power P.C. board.* 3 **Replace the outdoor power P.C. board.* 4 **Replace the outdoor power P.C. board.* 5 **Replace the outdoor power P.			6 times	Not lighted	Pre-heating protection	Overcurrent is detected during pre-heating.	Refer to 11-6.© "How to check inverter/ compressor".
9 times Not lighted Bus-bar voltage protection The bus-bar voltage exceeds 400 V or falls to low level during compressor operating. • Replace the outdoor power P.C. board or the outdoor control P.C. board. • Refer to 11-6. ③ "Check of bus-bar voltage".	19		8 times	Not lighted	Converter protection		Replace the outdoor power P.C. board.
			9 times	Not lighted	protection		 Replace the outdoor power P.C. board or the out- door control P.C. board.
	21		11 times	Not lighted		The ambient became -12°C or less.	_

No.	Symptom	Indication		Abnormal point / Con-		Remedy	
INO.	Symptom	LED1(Red)	LED2(Yellow)	dition	Condition	Reffiedy	
22	'Outdoor unit stops and	13 times	Not lighted	Outdoor fan motor	A failure occurs 3 consecutive times within 30 seconds after the fan gets started.	Refer to 11-6. © "Check of outdoor fan motor".	
23	restarts 3 minutes	Lighted 8 times Current sensor protection A short or open circuit is detected in the current sensor during compressor operating.		Replace the outdoor power P.C. board.			
24	later' is repeated.	Lighted	11 times	Communication between P.C. boards protection	Communication error occurs between the outdoor control P.C. board and outdoor power P.C. board for more than 10 seconds.	Check the connecting wire between outdoor control P.C. board and outdoor power P.C. board.	
25		Lighted	12 times	Zero cross detecting circuit (Outdoor power P.C. board)	Zero cross signal cannot be detected while the compressor is operating.	Replace the outdoor power P.C. board.	
26	Outdoor unit operates.	Once	Lighted	Primary current protection	The input current exceeds 13.6 A (MXZ-2E53VAHZ)/ 15 A (MXZ-3E54VA/3E68VA/4E72VA)/18.4 A (MXZ- 4E83VA/5E102VA)/25 A (MXZ-4E83VAHZ).	These symptoms do not mean any abnormality of the product, but check the following points. • Check if indoor filters are clogged.	
27		Twice	Lighted	High-pressure protection	The indoor gas pipe temperature exceeds 45°C during heating.	 Check if indoor inters are clogged. Check if refrigerant is short. Check if indoor/outdoor unit air circulation is short. 	
		TWICC	Ligiticu	Defrosting in cooling	The indoor gas pipe temperature falls 3°C or below during cooling.	cycled.	
28		3 times	Lighted	Discharge temperature protection	The frequency of the compressor is kept 80 Hz or more and the discharge temperature is kept under 50°C(COOL mode)/40°C(HEAT mode) for more than 40 minutes.	Check refrigerant circuit and refrigerant amount. Refer to 11-6. © "Check of LEV". Refer to 11-6. © "Check of outdoor thermistors".	
29		4 times	Lighted	Low discharge temperature protection	The frequency of the compressor is kept 80 Hz or more and the discharge temperature is kept under 39°C for more than 20 minutes.	Refer to 11-6. "Check of LEV". Check refrigerant circuit and refrigerant amount.	
30			The outdoor heat exchanger temperature exceeds 58°C during operation.	This symptom does not mean any abnormality of the product, but check the following points. • Check if indoor filters are clogged. • Check if refrigerant is short. • Check if indoor/outdoor unit air circulation is short cycled.			
31		7 times	Lighted	High → Low Pressure bypass valve Cooling evaporating temperature drop prevention control	During cooling operation, the temperature of indoor heat exchanger becomes 3°C or less within 1 hour after the compressor starts running, or it becomes less than 12°C - 16°C* later than that. * It depends on the difference between the set temperature and the room temperature.	This symptom does not mean any abnormality of the product, but check the following points. • Check the indoor filters are not clogged. • Check there is sufficient refrigerant. • Check the indoor/outdoor unit air circulation is not short cycled.	
32		11 times	Lighted	M-NET communication error	M-NET adapter P.C. board detects an abnormality in the communication error.	Check the connecting wire between M-NET adapter P.C. board and outdoor control P.C. board, or terminal block.	
33	Outdoor unit operates normally.			High → Low pressure bypass valve High pressure protec- tion control at start-up of heating operation	MXZ-4E83VAHZ The room temperature is 24°C or more when 1 or 2 unit(s) start(s) the heating operation.	This symptom does not mean any abnormality of the product.	
		7 times	Lighted	High → Low pressure bypass valve Compressor oil temper- ing control at start-up of heating operation	MXZ-4E83VAHZ Both the following are true: • The outside temperature is -2°C or less when the heating operation is started. • [(Discharge temperature) - (Indoor heat exchanger temperature)] < 5°C		
34		8 times	Lighted	Cooling evaporating temperature protection	During cooling operation, the temperature of indoor heat exchanger becomes 7°C - 11°C* or less within 1 hour after the compressor starts running, or it becomes 9°C - 17°C* or less later than that. * It depends on the indoor unit type/model or the difference between the set temperature and the room temperature.		
35		9 times	Lighted	Inverter check mode	The unit is operated with emergency operation switch.	_	
36		Lighted	Lighted	Normal		_	

NOTE 1. The location of LED is illustrated at the right figure. Refer to 11-7.1.

2. LED is lighted during normal operation.

The flashing frequency shows the number of times the LED blinks after every 2.5-second OFF. (Example) When the flashing frequency is "2".

ON OFF 2.5-second OFF 2.5-second OFF




11-5. TROUBLE CRITERION OF MAIN PARTS

MXZ-3E54VA MXZ-3E68VA MXZ-4E72VA MXZ-4E83VA MXZ-5E102VA MXZ-2E53VAHZ MXZ-4E83VAHZ


Part name	Check method and criterion							
Defrost thermistor (RT61) Fin temperature thermistor (RT64) Ambient temperature thermistor (RT65) Outdoor heat exchanger temperature thermistor (RT68)	Measure the resistance with a tester. Refer to 11-7. "Test point diagram and voltage", 1. "Outdoor control P.C.board", 2. "Outdoor power P.C. board", for the chart of thermistor.							
Discharge temperature thermistor (RT62)	Before measureme	Measure the resistance with a tester. Before measurement, hold the thermistor with your hands to warm it up. Refer to 11-7. "Test point diagram and voltage",1. "Outdoor control P.C. board" for the chart of thermistor.						
Compressor	Measure the resist (Winding temperate	tance be ure: -10	etween termi °C ~ 40 °C)	nals using a t	ester.			
			Normal (E	ach phase)				
V NHT BLK	MXZ-3E54VA	MXZ-3	-3E68/4E72VA MXZ-4E83/5E102VA MXZ-4E83V		MXZ-4E83VAHZ			
J. J	0.86 Ω ~ 1.06 Ω	0.63	$\Omega \sim 0.78 \Omega$	0.83 Ω ~ 1.0	03 Ω	0.77 Ω ~ 0.95 Ω		
Outdoor fan motor	• Refer to 11-6							
	Measure the resistance using a tester. (Part temperature: -10 °C ~ 40 °C)							
			Normal (E	ach phase)				
R.V. coil	MXZ-3E54/3E68/4	5//3F68//F72V/A		Z-4E83/5E102VA XZ-2E53VAHZ		(Z-4E83VAHZ		
	1.26 kΩ ~ 1.62	.62 kΩ 1.20 kΩ ~ 1.77 kΩ		1.24	kΩ ~ 1.86 kΩ			
Linear expansion valve	Measure the resist	ance us	sing a tester.	Part tempera	ture: -10	0 °C ~ 40 °C)		
WHT		Color of lead wire Normal				,		
RED (LEV)	WHT - RED							
ORN - 7000¥0001	RED - ORN		37.4 Ω ~ 53.9 Ω					
YLW BLU	YLW - RED		37.4 12~33.9 12					
	RED - BLU	RED - BLU						
High pressure switch			Pressure			Normal		
(HPS)	HPS	3.43 ± 0.15 MPa				Close		
	1113	4.41 ± 0.1 MPa				Open		


11-6. TROUBLESHOOTING FLOW

Outdoor unit does not operate.

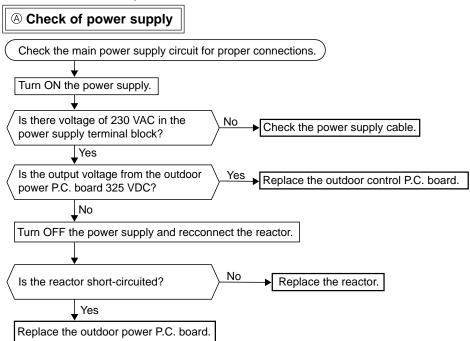



- When unit cannot operate neither by the remote controller nor by EMERGENCY OPERATION switch.
 Indoor unit does not operate.
- When OPERATION INDICATOR lamp flashes ON and OFF in every 0.5-second.
 Outdoor unit does not operate.



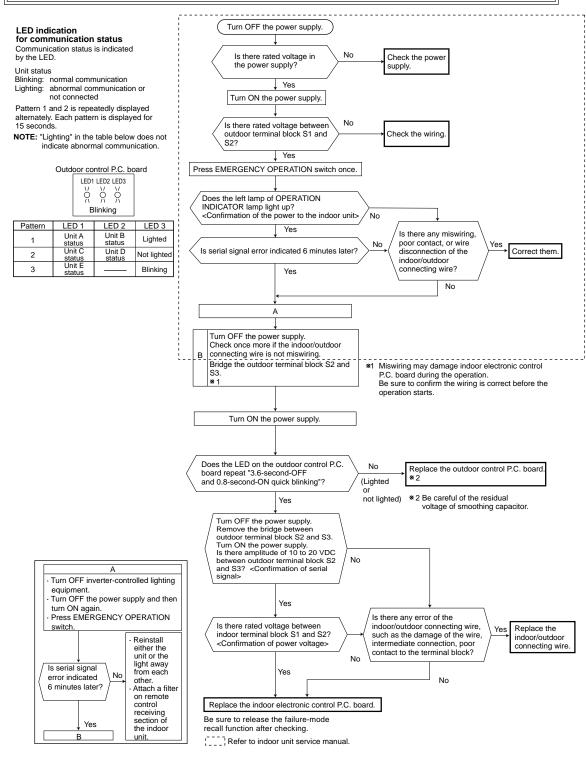


The cooling operation or heating operation does not operate.



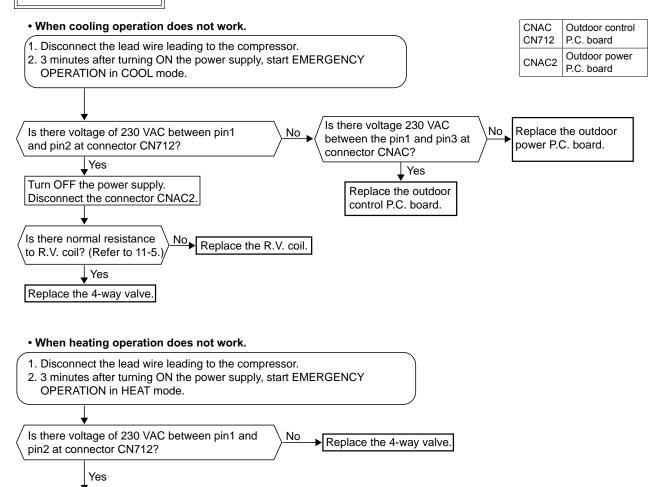


Replace the outdoor control P.C. board.

- When cooling, heat exchanger of non-operating indoor unit frosts.
- When heating, non-operating indoor unit gets warm.

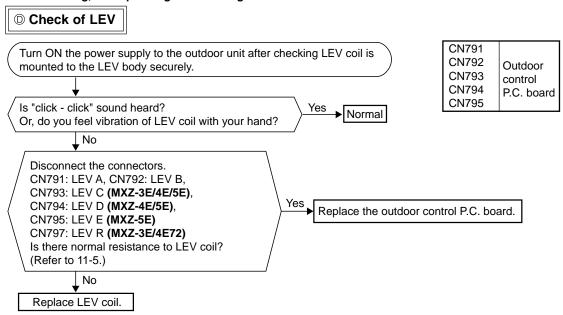


- · When heating, room does not get warm.
- When cooling, room does not get cool.
- E How to check inverter/compressor

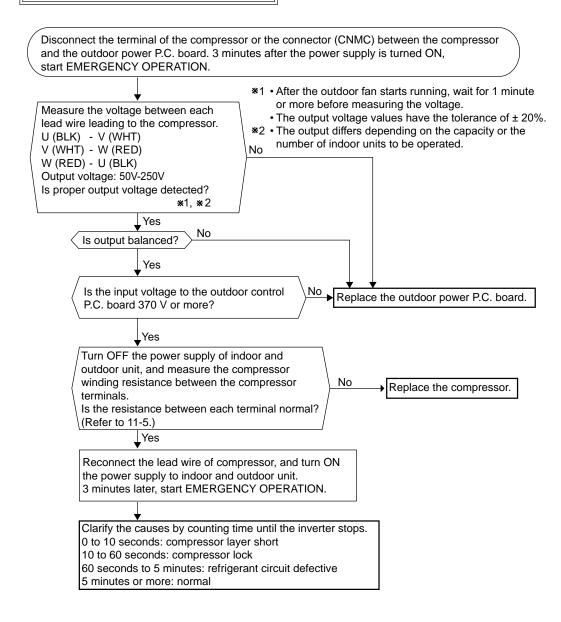

88


· When thermistor is abnormal.

© Check of outdoor thermistors

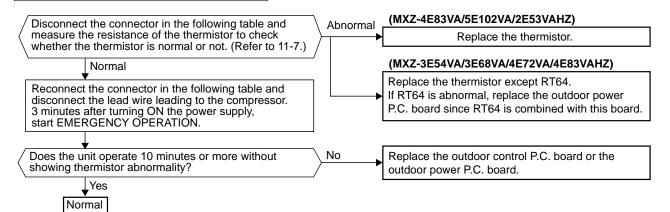


Thermistor	Symbol	Connector, Pin No.	Board
Defrost	RT61	Between CNTH1 pin1 and pin2	
Discharge temperature	RT62	Between CNTH1 pin3 and pin4	Outdoor control P.C. board
Outdoor heat exchanger temperature	RT68	Between CNTH1 pin7 and pin8	Outdoor control P.C. board
Ambient temperature	RT65	Between CNTH2 pin1 and pin2	
Fin temperature	RT64	Between CN171 pin1 and pin2	Outdoor power P.C. board

• Fan motor does not operate or stops operating shortly after starting the operation.

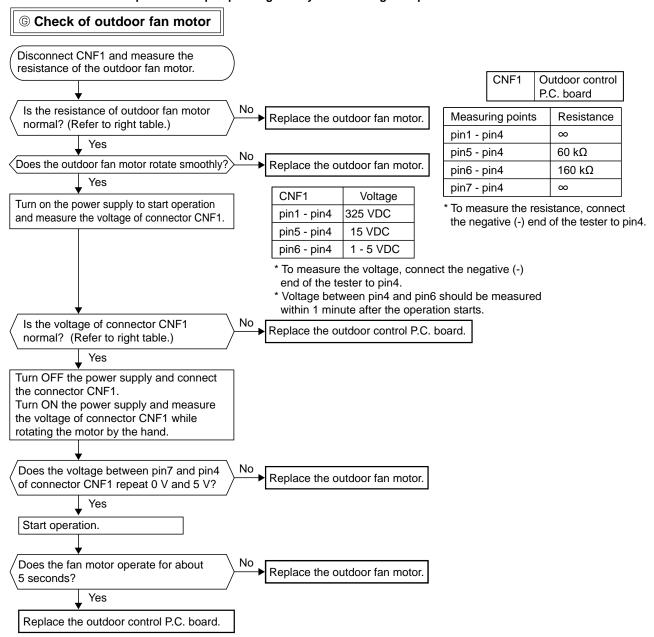

· When the operation frequency does not go up from the lowest frequency.

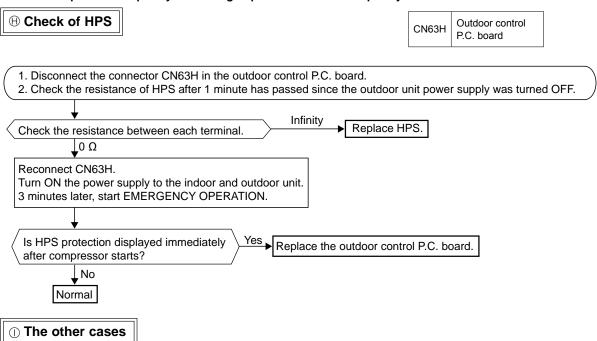

Indoor unit does not operate. (different operating models in multi system)

- When you try to run 2 indoor units simultaneously, one for cooling and the other for heating, the unit which transmits signal to the outdoor units first decides the operation mode.
- When the above situation occurs, set all the indoor units to the same mode, turn OFF the indoor units, and then turn them back ON.
- Though the top of the indoor unit sometimes gets warm, this does not mean malfunction. The reason is that the refrigerant gas continuously flows into the indoor unit even while it is not operating.

